


Colour	Pipe Size
Blue	1/4"
Red	3/8"
Green	1/2"

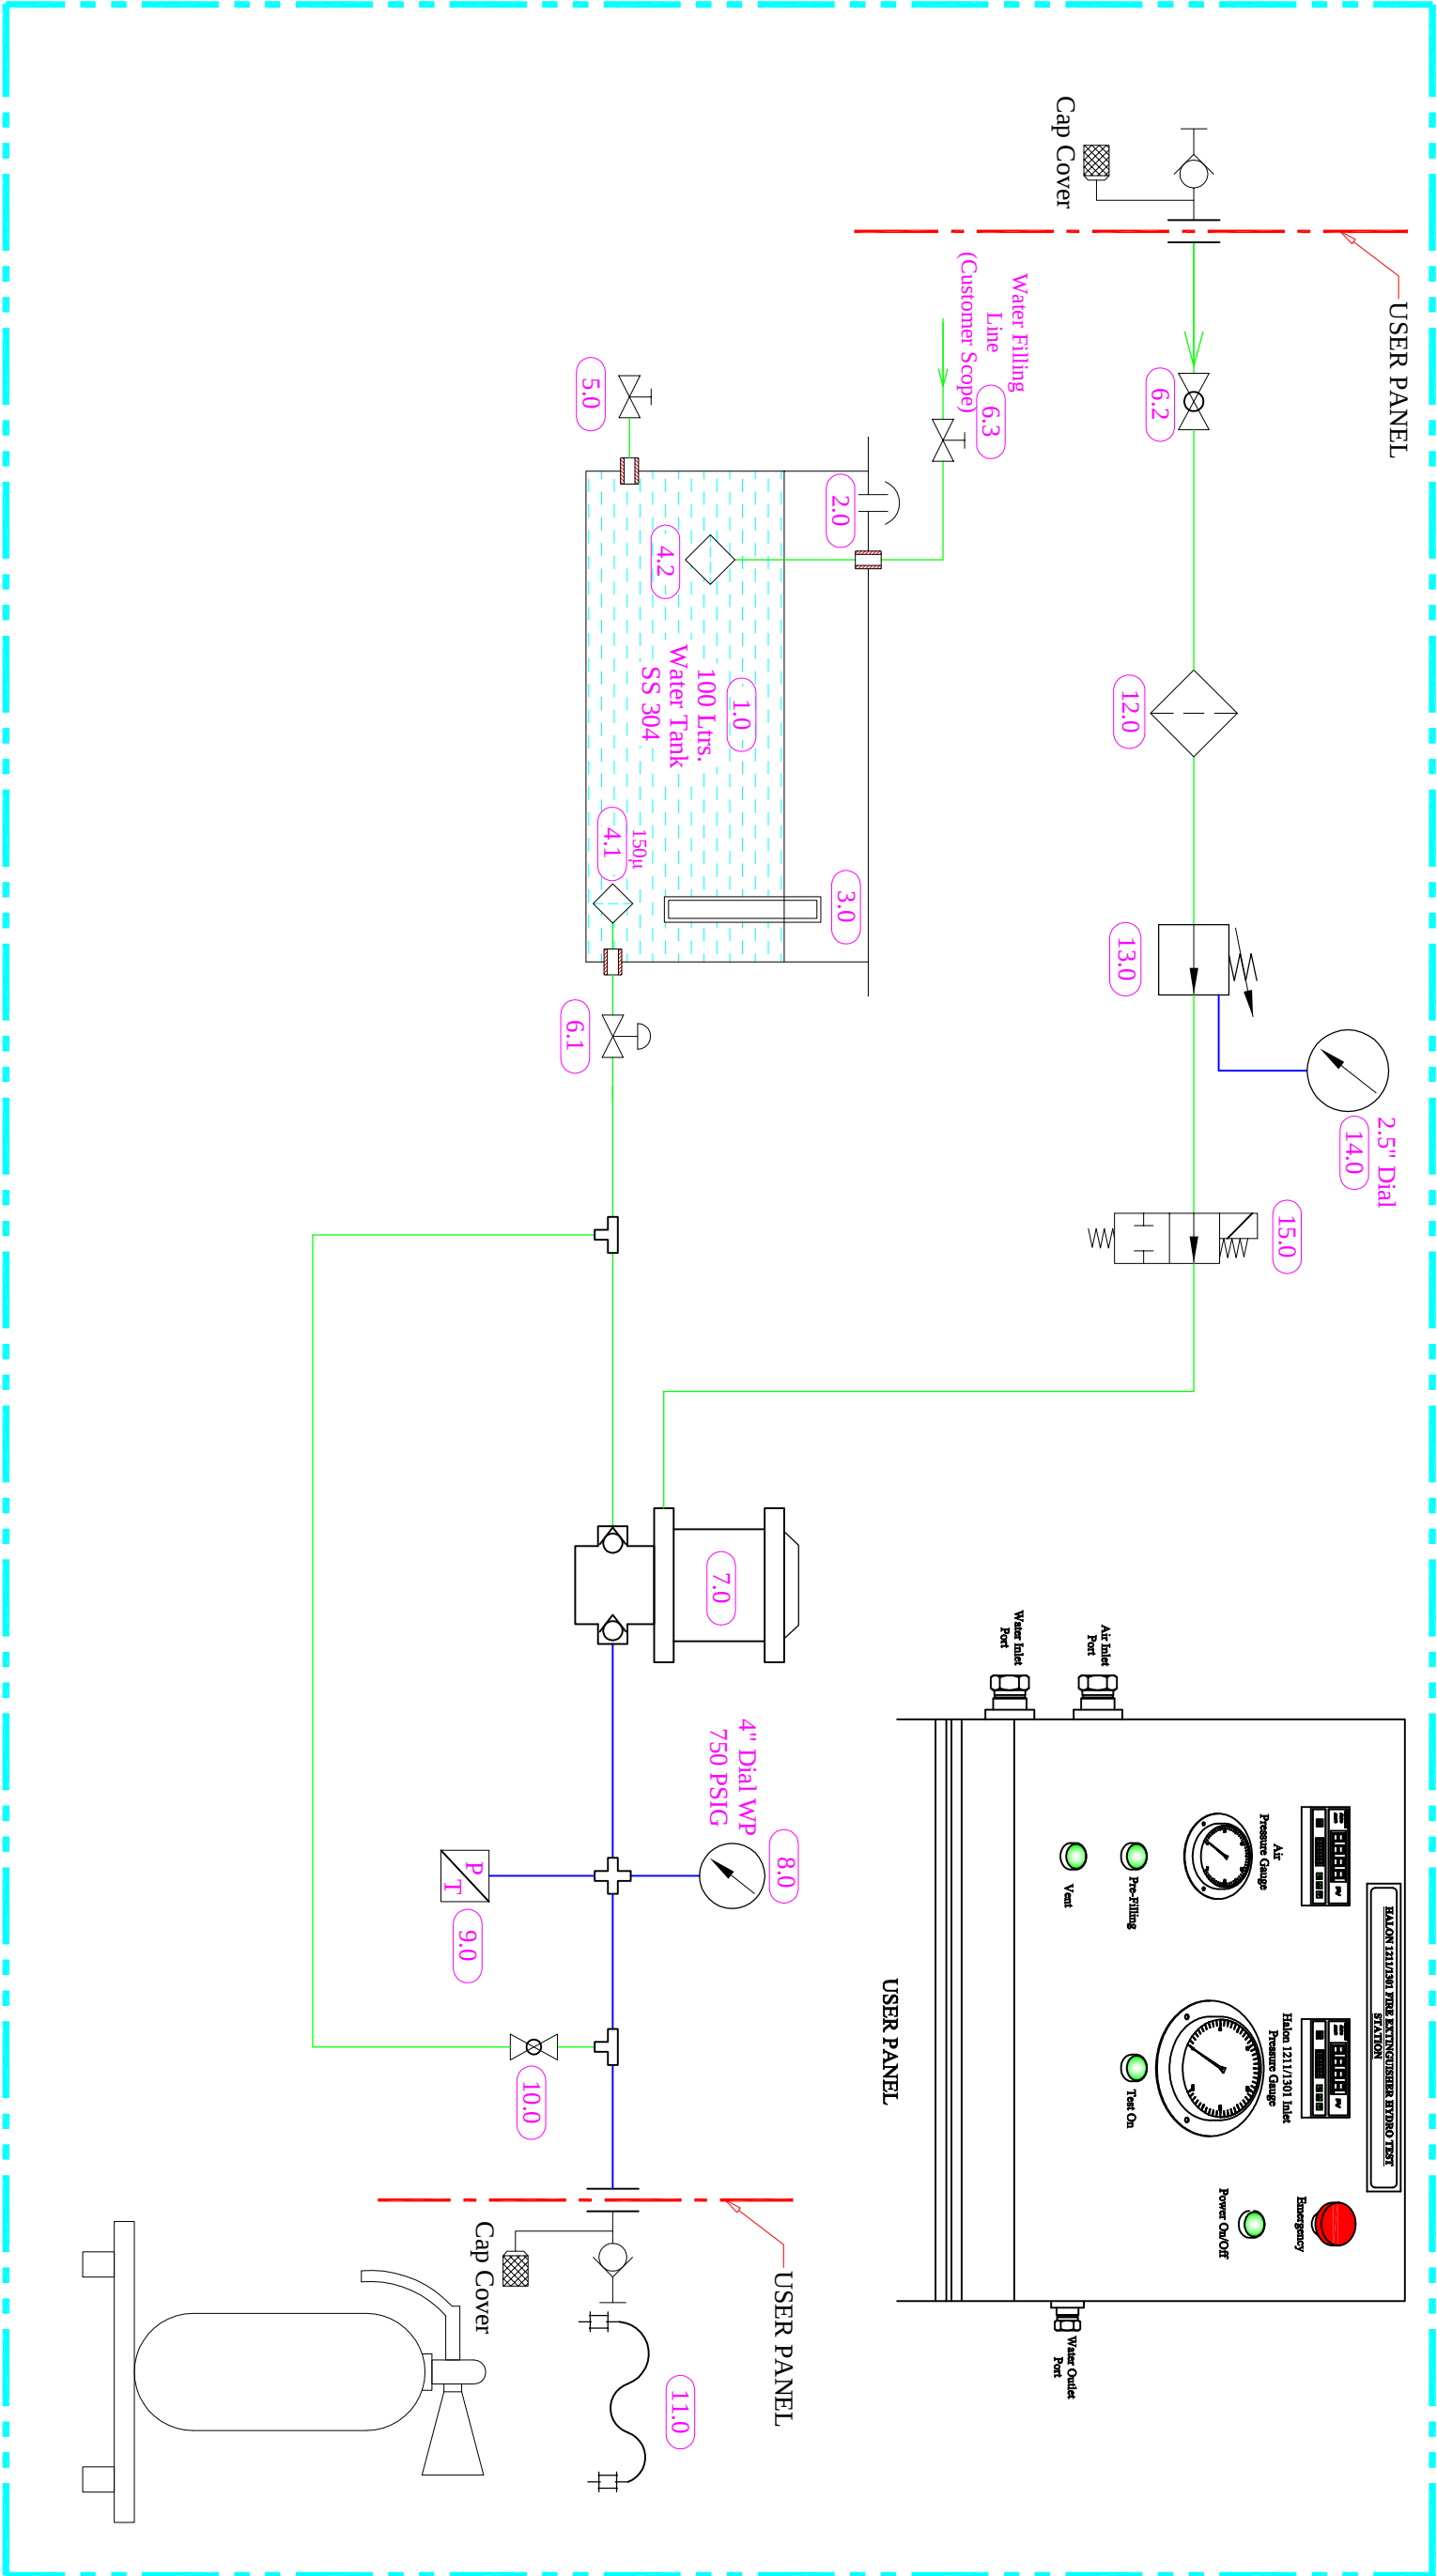

HALON 1211/1301 FIRE EXTINGUISHER HYDRO TEST STATION

Qty- 01 No.

NEOMETRIX		NEOMETRIX ENGINEERING PRIVATE LIMITED	
www.neometrixtechnology.com		E-148, SECTOR-43, NOIDA-201301 (U.P.)	
Tel. No. - 0120-4500880		Fax No. - 0120-4500880	
E-Mail: comet@neometrix.in			

MAIN TITLE	HALON RECLAMATION & REFILLING FACILITY	D/A No.	
SUB - TITLE	Halon 1211/1301 Fire Extinguisher Hydro Test Station	CROSS REF. DOC.	-
CODE	A1183	CUSTOMER DWG. / REF. No.	
CUSTOMER	INDIAN AIR FORCE	NOTES	-
END USER	24EDAF, MANAURI, ALLAHABAD		
REP NO.	AIR HQ/DPR/VI/125022 DATED 30 MARCH 2011		
PROJECTION	IS: 1500:2011	SHEET	NEOMETRIX DWG. NO.
CHECKED BY & DATE	SK 15/06/2011	DESIGN	Rev.
APPROVED BY & DATE	DT 15/06/2011	SIZE	SC.A4
	NTS	DT 101	00

Note :-
1. This is tentative drawing for **Tender Quotation** and is subject to change.